



# Parks, Recreation and Historic Preservation

## Questions and Responses

C003526

Operations and Maintenance of Hamlin Beach State  
Park Wastewater Treatment Plant

07/09/21

No.	IFB Section	IFB Page	Question	Response
1	General		I would like to request a current copy of the contract. I would also like to request a copy of invoices from the last calander year.	Your request involves an open procurement and disclosing this information at this time "would impair present or imminent contract awards or collective bargaining negotiations," Your request is denied pursuant to Public Officers Law §87(2)(c).
2	General		We would like to request a copy of the current SPDES permit.	Attached is a copy of the current SPDES permit.



Department of Environmental Conservation

# State Pollutant Discharge Elimination System (SPDES) DISCHARGE PERMIT

Industrial Code:	8999	SPDES Number:	NY0158119
Discharge Class (CL):	02	DEC Number:	8-2630-00012/00001
Toxic Class (TX):	N	Effective Date (EDP):	03/01/2015
Major Drainage Basin:	03	Expiration Date (ExDP):	02/29/2020
Sub Drainage Basin:	01	Modification Dates: (EDPM)	01/01/2018
Water Index Number:	ONT		
Compact Area:	IJC		

This SPDES permit is issued in compliance with Title 8 of Article 17 of the Environmental Conservation Law of New York State and in compliance with the Clean Water Act, as amended, (33 U.S.C. ' 1251 et.seq.)(hereinafter referred to as "the Act").

### PERMITTEE NAME AND ADDRESS

Name:	NYS Office of Parks, Recreation & Historic Preservation	Attention:	Michael Petti, P.E., Facility Manager
Street:	One Letchworth State Park		
City:	Castile	State:	NY
		Zip Code:	14427

is authorized to discharge from the facility described below:

### FACILITY NAME AND ADDRESS

Name:	Hamlin Beach State Park		
Location (C,T,V):	Hamlin (T)	County:	Monroe
Facility Address:	1 Hamlin Beach Blvd., West		
City:	Hamlin	State:	NY
From Outfall No.:	See Attached Summary	at Latitude:	43 ° 21 ' 06 " & Longitude: 77 ° 56 ' 47 "

into receiving waters known as: West branch ONT-131-1A to Lake Ontario Class: B

and (list other Outfalls, Receiving Waters & Water Classifications)

in accordance with: effluent limitations; monitoring and reporting requirements; other provisions and conditions set forth in this permit; and 6 NYCRR Part 750-1and 750-2.


### DISCHARGE MONITORING REPORT (DMR) MAILING ADDRESS

Mailing Name:	
Street:	
City:	State: Zip Code:
Responsible Official or Agent:	Phone:

This permit and the authorization to discharge shall expire on midnight of the expiration date shown above and the permittee shall not discharge after the expiration date unless this permit has been renewed, or extended pursuant to law. To be authorized to discharge beyond the expiration date, the permittee shall apply for permit renewal not less than 180 days prior to the expiration date shown above.

#### DISTRIBUTION:

CO BWP - Permit Coordinator  
 RWE - R8, Avon  
 RPA - R8, Avon  
 Monroe County Health Department  
 US EPA- Region 2  
 IJC

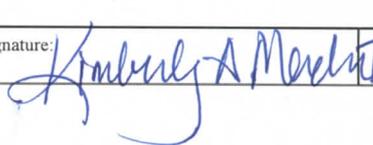Deputy Permit Administrator: Kimberly Merchant	
Address: 6274 East Avon Lima Rd Avon, NY 14414	
Signature: 	Date: 11/17/2017

## PERMIT LIMITS, LEVELS AND MONITORING DEFINITIONS

OUTFALL	WASTEWATER TYPE	RECEIVING WATER	EFFECTIVE	EXPIRING
	This cell describes the type of wastewater authorized for discharge. Examples include process or sanitary wastewater, storm water, non-contact cooling water.	This cell lists classified waters of the state to which the listed outfall discharges.	The date this page starts in effect. (e.g. EDP or EDPM)	The date this page is no longer in effect. (e.g. ExDP)

PARAMETER	MINIMUM	MAXIMUM	UNITS	SAMPLE FREQ.	SAMPLE TYPE
e.g. pH, TRC, Temperature, D.O.	The minimum level that must be maintained at all instants in time.	The maximum level that may not be exceeded at any instant in time.	SU, °F, mg/l, etc.	See below	See below

PARAMETER  
EFFLUENT LIMIT or CALCULATED LEVEL

COMPLIANCE LEVEL/ ML	ACTION LEVEL	UNITS	SAMPLE FREQUENCY	SAMPLE TYPE
	Limit types are defined below in Note 1. The effluent limit is developed based on the more stringent of technology-based limits, required under the Clean Water Act, or New York State water quality standards. The limit has been derived based on existing assumptions and rules. These assumptions include receiving water hardness, pH and temperature; rates of this and other discharges to the receiving stream; etc. If assumptions or rules change the limit may, after due process and modification of this permit, change.	For the purposes of compliance assessment, the permittee shall use the approved EPA analytical method with the lowest possible detection limit as promulgated under 40CFR Part 136 for the determination of the concentrations of parameters present in the sample unless otherwise specified. If a sample result is below the detection limit of the most sensitive method, compliance with the permit limit for that parameter was achieved. Monitoring results that are lower than this level must be reported, but shall not be used to determine compliance with the calculated limit. This PQL can be neither lowered nor raised without a modification of this permit.	Action Levels are monitoring requirements, as defined below in Note 2, which trigger additional monitoring and permit review when exceeded.	This can include units of flow, pH, mass, temperature, or concentration. Examples include µg/l, lbs/d, etc. Examples include Daily, 3/week, weekly, 2/month, monthly, quarterly, 2/yr and yearly. All monitoring periods (quarterly, semiannual, annual, etc) are based upon the calendar year unless otherwise specified in this Permit.

Notes:

1. EFFLUENT LIMIT TYPES:

- a. **DAILY DISCHARGE:** The discharge of a pollutant measured during a calendar day or any 24-hour period that reasonably represents the calendar day for the purposes of sampling. For pollutants expressed in units of mass, the 'daily discharge' is calculated as the total mass of the pollutant discharged over the day. For pollutants with limitations expressed in other units of measurement, the 'daily discharge' is calculated as the average measurement of the pollutant over the day.
- b. **DAILY MAX.:** The highest allowable daily discharge. **DAILY MIN.:** The lowest allowable daily discharge.
- c. **MONTHLY AVG:** The highest allowable average of daily discharges over a calendar month, calculated as the sum of each of the daily discharges measured during a calendar month divided by the number of daily discharges measured during that month.
- d. **7 DAY ARITHMETIC MEAN (7 day average):** The highest allowable average of daily discharges over a calendar week.
- e. **30 DAY GEOMETRIC MEAN:** The highest allowable geometric mean of daily discharges over a calendar month, calculated as the antilog of: the sum of the log of each of the daily discharges measured during a calendar month divided by the number of daily discharges measured during that month.
- f. **7 DAY GEOMETRIC MEAN:** The highest allowable geometric mean of daily discharges over a calendar week.
- g. **RANGE:** The minimum and maximum instantaneous measurements for the reporting period must remain between the two values shown.

2. **ACTION LEVELS:** Routine Action Level monitoring results, if not provided for on the Discharge Monitoring Report (DMR) form, shall be appended to the DMR for the period during which the sampling was conducted. If the additional monitoring requirement is triggered as noted below, the permittee shall undertake a short-term, high-intensity monitoring program for the parameter(s). Samples identical to those required for routine monitoring purposes shall be taken on each of at least three consecutive operating and discharging days and analyzed. Results shall be expressed in terms of both concentration and mass, and shall be submitted no later than the end of the third month following the month when the additional monitoring requirement was triggered. Results may be appended to the DMR or transmitted under separate cover to the same address. If levels higher than the Action Levels are confirmed, the permit may be reopened by the Department for consideration of revised Action Levels or effluent limits. The permittee is not authorized to discharge any of the listed parameters at levels which may cause or contribute to a violation of water quality standards.

### PERMIT LIMITS, LEVELS AND MONITORING

OUTFALL	LIMITATIONS APPLY:	RECEIVING WATER	EFFECTIVE	EXPIRING
001	Year Round	West branch ONT-131-1A	01/01/2018 (1)	02/29/2020

PARAMETER	EFFLUENT LIMIT					MONITORING REQUIREMENTS				FN
	Type	Limit	Units	Limit	Units	Sample Frequency	Sample Type	Location		
								Inf	Eff.	
Flow	Monthly Average	25000			gpd	Continuous	Instantaneous	X		3
BOD <sub>5</sub>	Daily Maximum	5	mg/l		lbs/d	Once/Qtr	Grab		X	4
Solids, Suspended	Daily Maximum	10	mg/l		lbs/d	Once/Qtr	Grab		X	4
Solids, Settleable	Daily Maximum	0.1	ml/l			Once/Qtr	Grab		X	4
pH	Range	6.5-8.5	SU			Once/Qtr	Grab		X	
Visual Observation	Monitor	---	mg/l			Daily	---		X	2
Nitrogen, as NH <sub>3</sub> , summer	Daily Maximum	1.2	mg/l			Once/Qtr	Grab		X	5
Nitrogen, as NH <sub>3</sub> , winter	Daily Maximum	2.2	mg/l			Once/Qtr	Grab		X	5
Dissolved Oxygen	Daily Minimum	7.0	mg/l			Once/Qtr	Grab		X	
Effluent Disinfection required		[ X ] All Year		[ ] Seasonal from __ to __						
Coliform, Fecal	30-Day Geometric Mean	200	No./100 ml			Once/Qtr	Grab		X	
Coliform, Fecal	7 Day Geometric Mean		No./100 ml							
Chlorine, Total Residual	Daily Maximum	20	ug/l			Daily	Grab		X	6

**FOOTNOTES:**

1) Plans and specifications for the sanitary system and treatment facility have been approved. Coordination shall be made with the RWE once completion occurs and before going on-line with the new treatment facility. The date of completion of the system shall not be later than November 30, 2020. The previous monitoring and permit requirements (listed as the interim limits listed as page 5 and 6 of this permit) will remain in effect until the construction and inspection of the new plans have been completed, approved by the Department and placed into service, which will be no later than November 20, 2020.

2) Visual observation is to check the area of the system and effluent for any treatment problems (overflows, operations routine checks, effluent not clear, etc.).

3) Flow meters will be maintained in line at package plant. When the treatment plant flow measurement reaches 85% of Design Flow for any monthly average during the park season (May-Oct), that will be the trigger for starting a flow management plan. A written Contingency Plan, with pre-made arrangements for hauling flow that comes in above the facility design peak limit of 50,000gpd for two days will also be submitted to the Regional DEC office, and used by the Park as needed.

4) The treatment units and ammonia limit in this permit cause the facility to be required to have a certified operator (NYWEA/NYSDEC) Grade 2A to manage the treatment facility. (See Part 650.) Sampling and laboratory results shall be taken for this facility every two (2) weeks until consistent compliance is achieved, and sent to DEC as soon as available. Once limitations are regularly achieved (two months of no violations), samples shall continue at monthly intervals for a minimum of six (6) months, and then reduce to quarterly samples, reported on the semi-annual report, if compliance continues.

5) Summer season is defined by June 1- October 31 and winter season by November 1-May 31.

6) If no chlorine chemical is used for disinfection, then no TRC sample is required. Water treatment chemical use shall be coordinated with the DOW, as per NYSDEC Water Treatment Chemical form and instructions on the DEC website.

## INTERIM OUTFALL SUMMARY

Outfall	Description	Design Flow (gpd)	Latitude/Longitude	Receiving Water/Class
001	LOSP Former Gas Station	2,000	43°21'18"/77°54'36"	Groundwater
002:	Maintenance Building	1,000	43°21'10"/77°56'59"	Groundwater
003	Park Entrance Toll Booth	150	43°21'30"/77°56'44"	Groundwater
004	Comfort Station East Area 1	5,000	43°21'43"/77°56'49"	Groundwater
005	Comfort Station Shelter Area 1 & New Park Office	3,200	43°21'47"/77°57'02"	Surface- Lake Ontario
006	Comfort Station West Wood & Concession Building Area 3	5,500	43°21'43"/77°56'49"	Groundwater
008	Bathhouse & Bathhouse North	12,988	43°21'51"/77°57'23"	Groundwater
009	Comfort Stations N & W of Area 4 & Concession Building Area 4	7,280	43°21'54"/77°57'54"	Surface- Lake Ontario
010	Comfort Station East of Area 4	2,000	43°21'56"/77°57'35"	Groundwater
011	Camping Contact Station	1,500	43°21'34"/77°57'02"	Groundwater
012	Trailer Dump Station	2,640	43°21'42"/77°57'03"	Surface- Lake Ontario
013	Camping A Shower Building	2,925	43°21'25"/77°56'58"	Surface- Lake Ontario
014	Camping B Shower Building	2,550	43°21'27"/77°57'12"	Surface Lake Ontario
015	Camping C-1 Shower Building	1,500	43°21'30"/77°57'17"	Surface- Lake Ontario
016	Camping C-2 Shower Building	1,500	43°21'31"/77°57'26"	Surface- Lake Ontario
017	Camping C-3 Shower Building	1,875	43°21'35"/77°57'27"	Surface- Lake Ontario
018	Camping D-1 Shower Building	3,000	43°21'38"/77°57'32"	Surface- Lake Ontario
019	Camping D-2 Shower Building	1,575	43°21'38"/77°57'32"	Surface- Lake Ontario
020	Camping E & F Shower Building	5,050	43°21'43"/77°57'41"	Surface- Lake Ontario
021	Campers Store/Laundry & Campers Center Comfort Station	3,500	43°21'36"/77°57'21"	Surface- Lake Ontario
022	Park Residence G-07	500	43°21'57"/77°58'10"	Surface- Lake Ontario
023	Park Residence G-08	500	43°21'04"/77°56'35"	Groundwater
024	Park Residence G-06	500	43°21'13"/77°56'58"	Groundwater
026	Parking Lot 5, East Comfort Station	7,500	43°21'53"/77°58'09"	Surface- Lake Ontario
027	Parking Lot 5 West Comfort Station	7,500	43°21'59"/77°58'30"	Surface- Lake Ontario

### INTERIM PERMIT LIMITS, LEVELS AND MONITORING

OUTFALL	LIMITATIONS APPLY:	RECEIVING WATER	EFFECTIVE	EXPIRING
All Surface Discharge Outfalls	Year Round	Lake Ontario	03/01/2015	02/29/2020 (1)

PARAMETER	EFFLUENT LIMIT					MONITORING REQUIREMENTS				FN
	Type	Limit	Units	Limit	Units	Sample Frequency	Sample Type	Location		
								Inf	Eff.	
Flow	Monthly Average	Design			gpd	Monthly	Instantaneous	X		2
CBOD <sub>5</sub>	Daily Maximum	20	mg/l		lbs/d	Once/year	Grab		X	
Solids, Suspended	Daily Maximum	20	mg/l		lbs/d	Once/year	Grab		X	
Solids, Settleable	Daily Maximum	0.1	ml/l			Once/year	Grab		X	
pH	Range	6.5-8.5	SU			Once/year	Grab		X	
Visual Observation	Monitor	---	mg/l			Daily	---		X	3
Effluent Disinfection required		[ X ] All Year			[ ] Seasonal from __ to __					
Coliform, Fecal	30-Day Geometric Mean	200	No./100 ml			Once/year	Grab		X	
Coliform, Fecal	7 Day Geometric Mean		No./100 ml							
Chlorine, Total Residual	Daily Maximum	1.0	ug/l			Daily	Grab		X	

FOOTNOTES:

- 1) These requirements will remain in effect until the construction and inspection of the new plans have been completed, approved by the Department and placed into service, which will be no later than November 20, 2020.
- 2) See the interim outfall summary for the design flows for each outfall.
- 3) Visual observation is to check the area of the system and effluent for any treatment problems (overflows, operations routine checks, effluent not clear, etc.).

## DISCHARGE NOTIFICATION REQUIREMENTS

- (a) Except as provided in (c) and (g) of these Discharge Notification Act requirements, the permittee shall install and maintain identification signs at all outfalls to surface waters listed in this permit. Such signs shall be installed before initiation of any discharge.
- (b) Subsequent modifications to or renewal of this permit does not reset or revise the deadline set forth in (a) above, unless a new deadline is set explicitly by such permit modification or renewal.
- (c) The Discharge Notification Requirements described herein do not apply to outfalls from which the discharge is composed exclusively of storm water, or discharges to ground water.
- (d) The sign(s) shall be conspicuous, legible and in as close proximity to the point of discharge as is reasonably possible while ensuring the maximum visibility from the surface water and shore. The signs shall be installed in such a manner to pose minimal hazard to navigation, bathing or other water related activities. If the public has access to the water from the land in the vicinity of the outfall, an identical sign shall be posted to be visible from the direction approaching the surface water.

The signs shall have **minimum** dimensions of eighteen inches by twenty four inches (18" x 24") and shall have white letters on a green background and contain the following information:

<p><b>N.Y.S. PERMITTED DISCHARGE POINT</b></p> <p><b>SPDES PERMIT No.: NY _____</b></p> <p><b>OUTFALL No. : _____</b></p> <p>For information about this permitted discharge contact:</p> <p>Permittee Name:</p> <p>_____</p> <p>Permittee Contact:</p>
--

(e) For each discharge required to have a sign in accordance with a), the permittee shall, concurrent with the installation of the sign, provide a repository of copies of the Discharge Monitoring Reports (DMRs), as required by the **RECORDING, REPORTING AND ADDITIONAL MONITORING REQUIREMENTS** page of this permit. This repository shall be open to the public, at a minimum, during normal daytime business hours. The repository may be at the business office repository of the permittee or at an off-premises location of its choice (such location shall be the village, town, city or county clerk's office, the local library or other location as

approved by the Department). In accordance with the **RECORDING, REPORTING AND ADDITIONAL MONITORING REQUIREMENTS** page of your permit, each DMR shall be maintained on record for a period of five years

- (f) The permittee shall periodically inspect the outfall identification sign(s) in order to ensure they are maintained, are still visible, and contain information that is current and factually correct. Signs that are damaged or incorrect shall be replaced within 3 months of inspection.


**DISCHARGE NOTIFICATION REQUIREMENTS (continued)**

- (g) All requirements of the Discharge Notification Act, including public repository requirements, are waived for any outfall meeting any of the following circumstances, provided Department notification is made in accordance with (h) below:
- (i) such sign would be inconsistent with any other state or federal statute;
  - (ii) the Discharge Notification Requirements contained herein would require that such sign could only be located in an area that is damaged by ice or flooding due to a one-year storm or storms of less severity;
  - (iii) instances in which the outfall to the receiving water is located on private or government property which is restricted to the public through fencing, patrolling, or other control mechanisms. Property which is posted only, without additional control mechanisms, does not qualify for this provision;
  - (iv) instances where the outfall pipe or channel discharges to another outfall pipe or channel, before discharge to a receiving water; or
  - (v) instances in which the discharge from the outfall is located in the receiving water, two-hundred or more feet from the shoreline of the receiving water.
- (h) If the permittee believes that any outfall which discharges wastewater from the permitted facility meets any of the waiver criteria listed in (g) above, notification (form enclosed) must be made to the Department's Bureau of Water Permits, Central Office, of such fact, and, provided there is no objection by the Department, a sign and DMR repository for the involved outfall(s) are not required. This notification must include the facility's name, address, telephone number, contact, permit number, outfall number(s), and reason why such outfall(s) is waived from the requirements of discharge notification. The Department may evaluate the applicability of a waiver at any time, and take appropriate measures to assure that the ECL and associated regulations are complied with.

### MONITORING LOCATIONS

The permittee shall take samples and measurements, to comply with the monitoring requirements specified in this permit, at the location(s) specified below:

**New surface discharge outfall:**

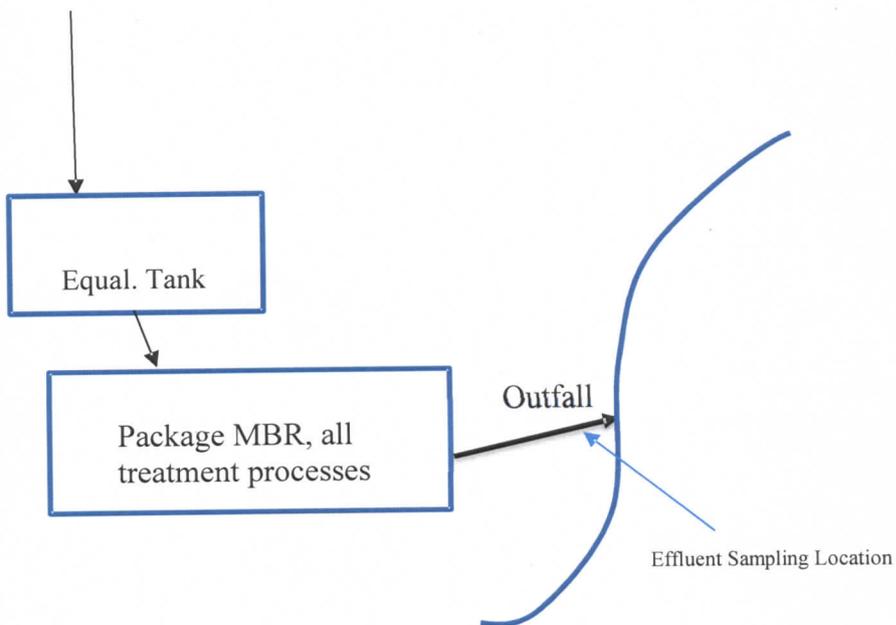

## GENERAL REQUIREMENTS

- A. The regulations in 6 NYCRR Part 750 are hereby incorporated by reference and the conditions are enforceable requirements under this permit. The permittee shall comply with all requirements set forth in this permit and with all the applicable requirements of 6 NYCRR Part 750 incorporated into this permit by reference, including but not limited to the regulations in paragraphs B through G as follows:
- B. General Conditions
- |  |   |
|--|---|
| 1. Duty to comply                                | 6NYCRR Part 750-2.1(e) & 2.4                |
| 2. Duty to reapply                               | 6NYCRR Part 750-1.16(a)                     |
| 3. Need to halt or reduce activity not a defense | 6NYCRR Part 750-2.1(g)                      |
| 4. Duty to mitigate                              | 6NYCRR Part 750-2.7(f)                      |
| 5. Permit actions                                | 6NYCRR Part 750-1.1(c), 1.18, 1.20 & 2.1(h) |
| 6. Property rights                               | 6NYCRR Part 750-2.2(b)                      |
| 7. Duty to provide information                   | 6NYCRR Part 750-2.1(i)                      |
| 8. Inspection and entry                          | 6NYCRR Part 750-2.1(a) & 2.3                |
- C. Operation and Maintenance
- |                                   |  |
|-----------------------------------|--|
| 1. Proper Operation & Maintenance | 6NYCRR Part 750-2.8                      |
| 2. Bypass                         | 6NYCRR Part 750-1.2(a)(17), 2.8(b) & 2.7 |
| 3. Upset                          | 6NYCRR Part 750-1.2(a)(94) & 2.8(c)      |
- D. Monitoring and Records
- |                           |   |
|---------------------------|---|
| 1. Monitoring and records | 6NYCRR Part 750-2.5(a)(2), 2.5(c)(1), 2.5(c)(2), 2.5(d) & 2.5(a)(6) |
| 2. Signatory requirements | 6NYCRR Part 750-1.8 & 2.5(b)  |
- E. Reporting Requirements
- |  |                                      |
|--|--------------------------------------|
| 1. Reporting requirements  | 6NYCRR Part 750-2.5, 2.6, 2.7 & 1.17 |
| 2. Anticipated noncompliance   | 6NYCRR Part 750-2.7(a)               |
| 3. Transfers   | 6NYCRR Part 750-1.17                 |
| 4. Monitoring reports  | 6NYCRR Part 750-2.5(e)               |
| 5. Compliance schedules  | 6NYCRR Part 750-1.14(d)              |
| 6. 24-hour reporting   | 6NYCRR Part 750-2.7(c) & (d)         |
| 7. Other noncompliance   | 6NYCRR Part 750-2.7(e)               |
| 8. Other information   | 6NYCRR Part 750-2.1(f)               |
| 9. Additional conditions applicable to a POTW                        | 6NYCRR Part 750-2.9                  |
| 10. Special reporting requirements for discharges that are not POTWs | 6NYCRR Part 750-2.6                  |
- F. Planned Changes
1. The permittee shall give notice to the Department as soon as possible of any planned physical alterations or additions to the permitted facility. Notice is required only when:
    - a. The alteration or addition to the permitted facility may meet of the criteria for determining whether facility is a new source in 40 CFR §122.29(b); or
    - b. The alteration or addition could significantly change the nature or increase the quantity of pollutants discharged. This notification applies to pollutants which are subject neither to effluent limitations in the permit, or to notification requirements under 40 CFR §122.42(a)(1); or
- G. SPDES Permit Program Fee
- The permittee shall pay to the Department an annual SPDES permit program fee within 30 days of the date of the first invoice, *unless otherwise directed by the Department*, and shall comply with all applicable requirements of ECL 72-0602 and 6 NYCRR Parts 480, 481 and 485. Note that if there is inconsistency between the fees specified in ECL 72-0602 and 6 NYCRR Part 485, the ECL 72-0602 fees govern.

## RECORDING, REPORTING AND ADDITIONAL MONITORING REQUIREMENTS

- A. The monitoring information required by this permit shall be summarized, signed and retained for a period of at least five years from the date of the sampling for subsequent inspection by the Department or its designated agent. **Also, monitoring information required by this permit shall be summarized and reported by submitting;**

(if box is checked) completed and signed Discharge Monitoring Report (DMR) forms for each \_\_\_\_ month reporting period to the locations specified below. Blank forms are available at the Department's Albany office listed below. The first reporting period begins on the effective date of this permit and the reports will be due no later than the 28th day of the month following the end of each reporting period.

(if box is checked) a semi-annual report to the Regional Water Engineer at the address specified below. The semi-annual report is due by April 1 and October 1 of each year, and must summarize information for the previous August-January and February- July in a format acceptable to the Department.

(if box is checked) a monthly "Wastewater Facility Operation Report..." (form 92-15-7) to the:

Regional Water Engineer and/or  County Health Department or Environmental Control Agency specified below

Send the **original** (top sheet) of each DMR page to:  
Department of Environmental Conservation  
Division of Water, Bureau of Water Compliance  
625 Broadway, Albany, New York 12233-3506  
Phone: (518) 402-8177

Send the **first copy** (second sheet) of each DMR page to:  
Department of Environmental Conservation  
Regional Water Engineer, Region 8  
6274 East Avon Lima Road  
Avon, NY 14414  
Phone: (585) 226-5450

Send an **additional copy** of each DMR page to:

- B. Monitoring and analysis shall be conducted according to test procedures approved under 40 CFR Part 136, unless other test procedures have been specified in this permit.
- C. More frequent monitoring of the discharge(s), monitoring point(s), or waters of the State than required by the permit, where analysis is performed by a certified laboratory or where such analysis is not required to be performed by a certified laboratory, shall be included in the calculations and recording of the data on the corresponding DMRs.
- D. Calculations which require averaging of measurements shall utilize an arithmetic mean unless otherwise specified in this permit.
- E. Unless otherwise specified, all information recorded on the DMRs shall be based upon measurements and sampling carried out during the most recently completed reporting period.
- F. Any laboratory test or sample analysis required by this permit for which the State Commissioner of Health issues certificates of approval pursuant to section 502 of the Public Health Law shall be conducted by a laboratory which has been issued a certificate of approval. Inquiries regarding laboratory certification should be directed to the New York State Department of Health, Environmental Laboratory Accreditation Program.